Nelsen Water Solutions

Quick Change, Twist & Loc

4-Stage Reverse Osmosis Drinking Water System




Easy Cartridge Removal & Replacement Without Turning Off Water

Designed to solve a wide variety of water quality issues, Nelsen reverse-osmosis drinking water systems provide you with compact, affordable and effective solutions for achieving the best possible quality drinking water for your home.


An innovative leader in water treatment since 1954, Nelsen assures you the highest quality and reliability in the industry. Nelsen Water Systems are sold, installed and serviced by independently owned and operated Nelsen Dealers nationwide.

NELSEN™
WATER SOLUTIONS
Quick Twist & Loc
Reverse Osmosis

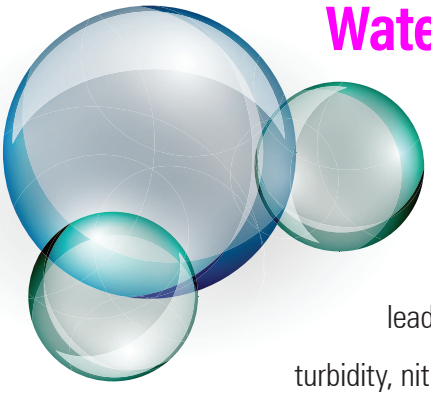

Water in its *Purest Sense*

Nelsen reverse-osmosis drinking water systems significantly reduce unwanted substances bigger than 0.0001" such as carcinogens, heavy metal ions such as cadmium, chromium, lead and mercury; chlorine, cryptosporidium, salts, turbidity, nitrate, VOC's, organic compounds, dissolved solids, tastes and odors leaving only clean, great tasting water.

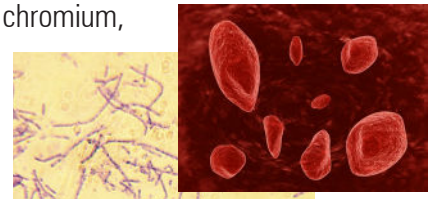

How does the *Process Work*

Reverse osmosis is the same process used by most major bottled water suppliers. With a Nelsen Reverse Osmosis Drinking Water System, you can have the same high-quality water available from your own faucet for a fraction of the cost of bottled water.

Just how does the reverse osmosis process work? During the process, water is forced through a semi-permeable membrane that traps contaminants. These contaminants are then flushed out of the system and down the drain, leaving your drinking water clean and fresh.

PRE-FILTER (Sediment)
Removes sediment, rust, dirt and other solid debris. Filters down to five microns.

PRE-FILTER (Carbon Block)
(Activated Carbon) Removes chlorine from the feed water to protect the membrane. Filters down to five microns.

RO MEMBRANE
Thin Film Composite design. Rejects 98% of the dissolved metals and salts, plus other harmful contaminants.

POST-FILTER (Carbon Block)
Removes any remaining objectional tastes and odors picked up in the storage tank.



How the *Quick Change, Twist & Loc* Works




Easy Cartridge Removal & Replacement WITHOUT Turning Off Water

Manifold




Cartridges

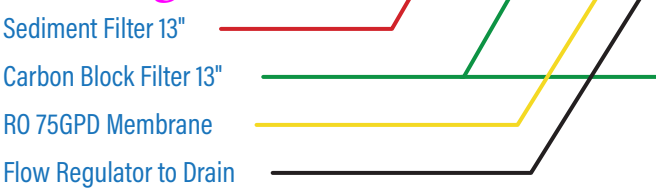

Installation

Installation Kit includes tubing, drain clamp, faucet, feed water angle stop adapter and storage tank shut-off valve.

Specifications

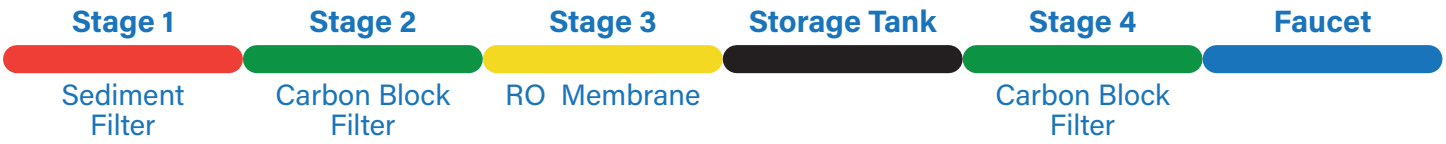

Gallons per day (L/day)* ..... 30.65 GPD (116.02 L/DAY)

Typical System Flow Sequence ..... ➡ Sediment Filter ➡ Carbon Block Pre-filter ➡ Reverse Osmosis Membrane ➡ Storage Tank ➡ Carbon Block Post-filter ➡ Dispensing Faucet

Sediment Filter (Stage 1) ..... 5 Micron

Carbon Block Pre-filter & Post-filter (Stage 2&4) ..... Carbon Block 5 Micron

Reverse Osmosis Membrane (Stage 3) ..... Thin Film Composite

Storage Capacity ..... Plastic Coated Metal – Capacity 3.2 Gallon (12 Liters)

	PURPOSE	MICRON RATING	CAPACITY	FLOW RATE	RATED LIFE	STAGE
Sediment Filter **PART# TWIST-SEDIMENT**	Sediment Reduction	5	2500 Gallons (9463 Liters)	0.5 gal/min 1.9 liters/min	6 Months	1
Carbon Filter **PART# TWIST-CARBON**	Chlorine, Taste & Odor	5				2 & 4

	PURPOSE	RECOVERY (PRODUCT WATER)	EFFICIENCY RATING	TDS REDUCTION	RATED LIFE	STAGE
RO Membrane **PART# TWIST-MEMBRANE-75**	TDS Reduction	30.57%	18.73%	91.1%	24 Months	3

RECOMMENDED FEED WATER CHARACTERISTICS		STAGE
Working Pressure	30 - 100 psi (207 - 690 kPa)	1. The reverse osmosis membrane used in these systems may be damaged by chlorine. These systems include activated carbon filters which protect the membranes by reducing chlorine. Influent chlorine should not exceed 3 mg/L
Temperature	39 - 100 °F (4 - 38 °C)	
pH range	5 - 10	
Turbidity	< 1.0 Net Turbidity (NTU)	
Hardness (CaCO3)	< 300 ppm	2. Additional information on factors that affect RO performance can be found in the "Performance & Technical Information" section.
Iron (Fe)	0 - 1 ppm	
Chlorine (Cl2)	0 - 3 ppm (0-3 mg/l)	

Represented by:

* The stated product performance is based on data taken after 30 minutes of operation at the following test conditions: 2,000 mg/L NaCl solution at 225 psig (1.5 MPa) applied pressure, 15% recovery, 77° F (25° C), pH 6.5–7.0

** Rated Life and Capacity are dependent on local water conditions and level of pre-filtration.

The disposable filter cartridges must be replaced every 6 months and 24 months for the system membrane, at the rated capacity or if a noticeable reduction in flow rate occurs.

Performance of the reverse osmosis membrane is affected by several factors which must be considered when judging the condition of the system. The main factors which affect system performance are pressure, temperature, total dissolved solids level, recovery and pH.

©Nelsen Corporation